



2026

Water Quality Report

INFORME DE CALIDAD DE AGUA

 DENVER WATER

WHAT IS THIS REPORT?

The Environmental Protection Agency requires public water suppliers that serve the same people year-round (community water systems) to provide consumer confidence reports to their customers. These reports are also known as annual water quality reports.

This report summarizes information regarding water sources used, any detected contaminants, compliance and educational information.

Where does your water come from?



Denver's drinking water comes from rivers, lakes, streams, reservoirs and springs fed by high-quality mountain snowmelt. Denver Water's supply is 100% surface water that covers about 4,000 square miles of watersheds on both sides of the Continental Divide.

Mountain water sources

Denver Water's water sources include the upper South Platte River, the upper Blue River, Bear Creek, South Boulder Creek, Ralston Creek, tributaries to the Fraser River, and the upper Williams Fork River. Denver Water stores its water in five mountain reservoirs: Antero, Eleven Mile Canyon, Cheesman, Dillon and Gross. From these reservoirs, the water is sent to the metro area through a complex system of streams, canals and pipes to be treated.



After treatment, drinking water is fed by both gravity and pumps to a system of underground, clean-water reservoirs before continuing to your home or business. More than 3,000 miles of water mains — enough to stretch from Los Angeles to New York — carry water to Denver Water customers.

Source water assessment

The Colorado Department of Public Health and Environment has completed a source water assessment of the potential for contaminants reaching any of Denver Water's three terminal reservoirs at Strontia Springs, Marston and Ralston, the last stop for water before it is treated. The potential sources of contamination that may exist are:



- EPA areas of concern.
- permitted wastewater.
- discharge sites.
- above-ground, underground and leaking storage tank sites.
- solid waste sites.
- existing or abandoned mine sites.
- other facilities.

Continued on the next page.

In this report:

What we test for

Denver Water has met all drinking water standards for regulated water contaminants. Test results are detailed on pages 8 to 13.

Monitoring requirements not met

In 2025, Denver Water failed to meet one monitoring requirement. This did not pose a safety risk and does not require any action from you. For details, see page 4.

Public board meetings

The Denver Board of Water Commissioners is responsible for setting water rates and monitoring the cost and maintenance of the water system. Public meetings are generally held twice a month. For a schedule and location of board meetings, visit denverwater.org/BoardMeetings.

Obtain a paper copy of this report

Paper copies of this report, in English or Spanish, can be requested through Denver Water Customer Care at **303-893-2444**, Monday through Friday, from 7:30 a.m. to 5:30 p.m. You can also email CustomerCare@denverwater.org.

Información importante acerca de la calidad del agua. Para recibir la versión en español del Informe de Calidad de Agua de 2026 de Denver Water, llame al departamento de servicio al cliente al **303-893-2444** o visite denverwater.org/2026CalidadDeAgua.

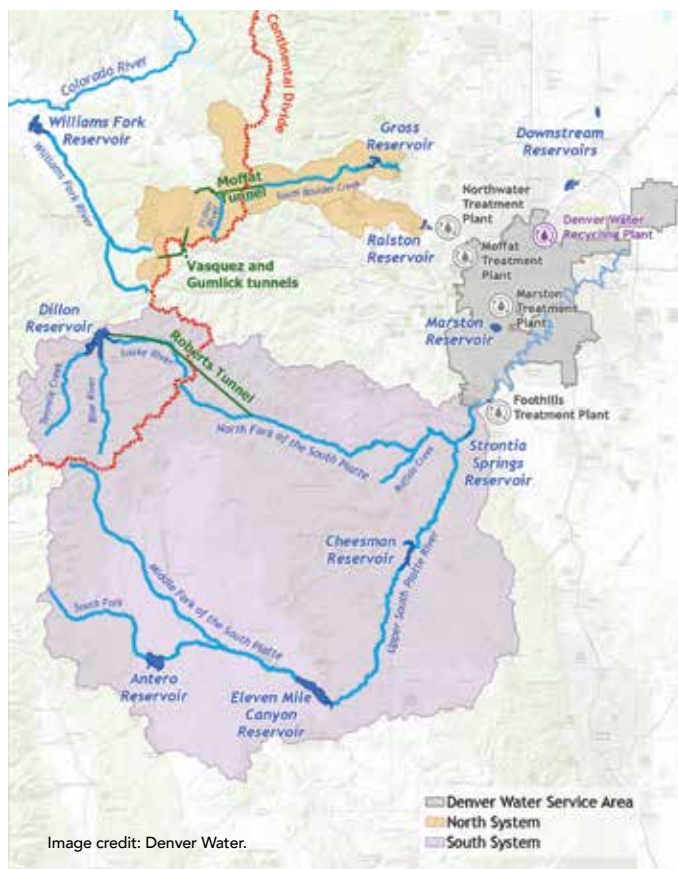


Image credit: Denver Water.

On the cover: In 2025, Denver Water scientists collected more than 58,000 water samples and conducted 128,000 tests to ensure customers always have clean, safe, high-quality drinking water. We're proud to report that Denver Water has met or exceeded all drinking water standards, detailed in the following report. Photo credit: Denver Water.

- commercial, industrial and transportation activities.
- residential, urban recreational grasses.
- quarries, strip mines and gravel pits.
- agriculture.
- forests.
- septic systems.
- oil and gas wells.
- roads.

The Source Water Assessment Report provides a screening-level evaluation of potential contamination that could occur. It does not mean that the contamination has or will occur. We can use this information to evaluate the need to improve our current water treatment capabilities and prepare for future contamination threats. This can help us ensure that high-quality drinking water is delivered to your home or business.

For general information, or to obtain a copy of the report, please visit wqcdcompliance.com/ccr. The report is located under "Guidance: Source Water Assessment Reports."

Search the table using 116001, Denver Water Board, or call Denver Water Customer Care at **303-893-2444**.

DENVER WATER'S SYSTEM

Devoted to water quality

Denver Water proudly serves high-quality water to 1.5 million people in the city of Denver and many surrounding suburbs. Since 1918, we have expertly planned, developed and operated a complex system that provides clean, safe, great-tasting water. Denver Water is a public agency funded by water rates, new tap fees and the sale of hydropower, not taxes. We are Colorado's oldest and largest water utility — Denver Water has a total water service area of approximately 300 square miles.

Denver Water serves 25% of the state's population with less than 2% of all the water used in the state. Our customers are our top priority. They rely on us to deliver a clean, reliable water supply every day, without fail. In turn, we depend on our customers to use our precious supply with the utmost efficiency. This partnership requires that we continually earn our customers' trust by listening to them and acting in their best interest, especially regarding water quality. In 2025, we collected more than 58,000 water samples and conducted about 128,000 tests. Denver Water is required by state and federal law to monitor for — and provide this report on — regulated contaminants in drinking water.

Denver Water also goes above and beyond these requirements to monitor for additional compounds in drinking water. This information is available on our website at denverwater.org/TreatedWater.

SOURCES OF DRINKING WATER



Cheesman Reservoir. Photo credit: Denver Water.

Sources of drinking water include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material. It can also pick up substances resulting from human activity and the presence of animals. Contaminants may include the following:

Microbial contaminants

Viruses, bacteria and other microbes that may come from sewage treatment plants, septic systems, agricultural livestock operations and wildlife.

Inorganic contaminants

Salts and metals, which can naturally occur or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining or farming.

Pesticides and herbicides

Chemical substances resulting from a variety of sources, such as agricultural and urban stormwater runoff, and residential uses.

Organic chemical contaminants

Substances such as synthetic and volatile organic chemicals, which are byproducts of industrial processes and petroleum production, and may come from gas stations, urban stormwater runoff and septic systems.

Radioactive contaminants

Substances that can be naturally occurring or be the result of oil and gas production and mining activities.

WATER AT A GLANCE

All drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants.

The presence of contaminants does not necessarily indicate that the water poses a health risk. In order to ensure that tap water is safe to drink, the Colorado Department of Public Health and Environment's regulations set limits on the amount of certain contaminants in water provided by public water systems. The Food and Drug Administration sets limits for contaminants in bottled water

to provide the same protection for public health.

More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency Safe Drinking Water Hotline at **800-426-4791** or by visiting epa.gov/ground-water-and-drinking-water.

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised people, such as people with cancer undergoing chemotherapy, people who

have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly and infants, can be particularly at risk of infections.

Those at risk should seek advice about drinking water from their health care providers. Guidelines from the EPA and the Centers for Disease Control and Prevention on appropriate ways to lessen the risk of infection by cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline, **800-426-4791**.

LEAD REDUCTION PROGRAM

Denver Water is committed to delivering safe water to our customers. Lead can get into water as it moves through customer-owned water service lines and household plumbing that contain lead.

Service lines bring water into a home or building from Denver Water's main delivery pipe in the street. In Denver Water's experience, homes built prior to 1951 are more likely to have lead service lines. Homes built before 1987 may have lead solder connecting copper pipes in their plumbing. Faucets and fixtures made before 2014 do not meet today's "lead-free" requirements. Lead exposure can cause serious health problems for all age groups, especially pregnant people and young children.

To address this issue, Denver Water has launched the Lead Reduction Program, which was approved in December 2019 by the Environmental Protection Agency and Colorado Department of Public Health and Environment.

The Lead Reduction Program has five main components:

- Managing our system's water chemistry, including an increased pH level to reduce the risk of lead

getting into drinking water from lead service lines or household plumbing.

- Maintaining (and updating) a publicly accessible inventory of all customer-owned lead service lines in Denver Water's service area. This interactive map is available at denverwater.org/Lead.
- Providing a free water pitcher and filters that are certified to remove lead to all customers suspected of having a lead service line until their line is replaced, and for six months after.
- Replacing the entire inventory of lead service lines within our service area with copper lines at no direct charge to the customer. When initially launched, all lead service lines were slated to be removed by 2035. Progress on service line replacements can be viewed on the program dashboard at denverwater.org/Lead.
- Ongoing communications, outreach and education to reach and engage with the diverse communities we serve.

How the program came to be

Since 1992, as part of the EPA's Lead

and Copper Rule, Denver Water has monitored water quality in homes that have service lines or plumbing that contain lead.

Only once, in 2012, did test results from those homes indicate additional action was needed to protect public health, and Denver Water remains in compliance today. However, Denver Water is still required to implement the best plan to reduce the risk of lead in tap water in homes with lead-containing plumbing or service lines. That plan is the Lead Reduction Program, which is now underway.

Learn more about this effort and the program at denverwater.org/Lead.

If you are concerned about lead, you can request to have your water tested. Denver Water customers can request a free lead test kit at denverwater.org/Leadtest.

Information on lead in drinking water, testing and steps to minimize exposure is available from the Safe Drinking Water Hotline at **800-426-4791**, at epa.gov/safewater/lead and at denverwater.org/Lead.

HOW TO MINIMIZE YOUR EXPOSURE TO LEAD

You share the responsibility of protecting yourself and your family from lead in your home's plumbing. You can take the following actions to reduce your household's risk of exposure.

Flush

If water has not been used in the property for a few hours, such as first thing in the morning or when coming home from work, run cold water from the kitchen or any bathroom faucet for five minutes. You can also run the dishwasher, take a shower or do a load of laundry to help flush water in your home's internal plumbing before drinking, cooking or preparing infant formula.



Replace old fixtures

Replace faucets and indoor plumbing with "lead-free" components. Faucets and fixtures installed prior to 2014 do not meet today's requirements for "lead-free" fixtures.



Clean aerators

A faucet aerator is a small screen added to the end of a faucet to mix air with water to reduce the flow of water coming from the faucet. Remove and clean the aerators on your faucets, as

they may have trapped particles from your old lead service line.

Maintain filters

Follow the manufacturer's maintenance schedule for the filtration system you have, including water pitchers, faucet-mounted filters, under-sink filter or refrigerator filters. The results of your water quality test may help to determine if you still wish to continue using a filter. Boiling the water does not remove lead.



You can find instructional videos on flushing and filter use at denverwater.org/Lead.

IS THERE A PRESENCE OF CRYPTOSPORIDIUM AND GIARDIA?

Denver Water has tested for Cryptosporidium (crypto) and giardia in both raw and treated water since the 1980s. Since that time, Denver Water has never detected a viable indication of either in drinking water.

Crypto and giardia are microscopic organisms that, when ingested, can cause diarrhea, cramps, fever and other gastro-intestinal symptoms. Crypto and giardia are usually spread through means other than drinking water.

While most people readily recover from the symptoms, crypto and giardia can cause more serious illness in people with compromised immune systems. The organisms are in many of Colorado's rivers and streams and are a result of animal waste in the watershed.

At the treatment plants, Denver Water removes crypto and giardia through effective filtration, and giardia is also killed by disinfection.



Denver Water has tested for cryptosporidium and giardia since the 1980s and has never detected a viable indication of either in drinking water. Photo credit: Denver Water.

WATER QUALITY VIOLATION

In 2025, our water system violated a drinking water monitoring requirement. Although this situation did not pose a safety risk and does not require you to take action, you have a right to know what happened and what we did to correct this situation.

We are required to regularly monitor your drinking water for specific contaminants. Results of regular monitoring indicate whether our drinking water meets health standards. During the three-year monitoring period from Jan. 1, 2023, to Dec. 31, 2025, we missed one monitoring and testing requirement for synthetic organic compounds at the Moffat Treatment Plant.

What happened?

The Colorado Department of Health

and Environment requires us to sample for synthetic organic compounds at Moffat Treatment Plant in two quarters over a three-year monitoring period. Moffat Treatment Plant is used for backup operations, typically during dry years, and was offline for much of the reporting period. Because of those limited operations, we only collected one set of samples during the monitoring period instead of the required two.

How did this impact water quality?

Synthetic organic compounds have not been detected at Moffat Treatment Plant in the past. In the 2024 sample taken at Moffat Treatment Plant, no synthetic organic compounds were detected. Additionally, no synthetic organic compounds were detected in samples

taken from Northwater Treatment Plant, which uses the same source water as Moffat, giving us confidence that no water quality impacts resulted from the missed sample set. For these reasons, there is no need to use alternative water supplies.

What was done?

Because of the seasonal operation of our treatment plants and the complexity of planned outages, we have implemented proactive, plant-specific compliance sampling schedules to ensure continued regulatory adherence. Compliance collections for synthetic organic compounds and other nonroutine sampling requirements are now scheduled for the earliest available monitoring period.

Please share this information with other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools and businesses). You can do this by posting this notice in public places or by distributing copies by hand.



Dillon Reservoir. Photo credit: Denver Water.

What is Denver Water doing about PFAS?

Denver Water is committed to ensuring a clean, safe water supply for our customers that meets or goes beyond state and federal drinking water standards.

We have tested for PFAS-related compounds in the source water that comes into our treatment plants and the drinking water that leaves the plants since 2017 and have not detected anything above the Environmental Protection Agency's new regulatory limits.

Learn more about PFAS monitoring at denverwater.org/PFAS.

Fluoride in Denver Water's treated water

Fluoride is a naturally occurring compound in Denver Water's source water. It enters the water when fluoride-rich minerals in soils and rock dissolve.

The Centers for Disease Control and Prevention recognizes the widespread adoption of community fluoridation as one of the 10 greatest public health achievements of the 20th century.

Since Denver Water began monitoring and managing the level of fluoridation in our water back in 1953, we have relied on the latest science from the foremost national and local authorities to inform our policy.

Learn more at denverwater.org/Fluoride.

THE TREATMENT PROCESS

The treatment process consists of five steps:

1 COAGULATION/ FLOCCULATION

Raw water is drawn into mixing basins at our treatment plants where we add positively charged coagulant and polymer to bond with the negatively charged particles that are suspended in the water that we want to remove. As the negatively charged particles and the positively charged coagulants are joined together, they form larger particles called floc.

2 SEDIMENTATION

Over time, the now larger floc particles become heavy enough to settle to the bottom of a basin from which sediment is removed.

3 FILTRATION



The water is then filtered through layers of filter media made of anthracite coal. As the water moves through the filter media, larger particles get caught in the spaces between the grains of anthracite, and clear water emerges.

4 DISINFECTION

As protection against any bacteria, viruses and other microbes that might remain, disinfectant is added before the water flows into underground reservoirs throughout the distribution system and into your home or business. Denver Water carefully monitors the amount of disinfectant added to maintain quality of the water at the farthest reaches of the system.

5 CORROSION CONTROL

Treatment operators maintain the water's pH by adding alkaline substances to make the water less corrosive. This helps strengthen an existing coating on the inside of water service lines. The coating reduces the potential for lead to get into the water.



REGULATED WATER CONTAMINANTS: WHAT IS IN THE WATER?

TERMS, ABBREVIATIONS AND SYMBOLS

Some of the terms, abbreviations and symbols contained in this report are unique to the water industry and might not be familiar to all customers. Terms used in the table are explained below.

action level (AL)

Concentration of a contaminant that, if exceeded, triggers treatment or other requirements that a water system must follow.

average

Typical value.

below reporting level (BRL)

Below the reportable level for an analysis or below the lowest reliable level that can be measured.

compliance value

Single or calculated value used to determine if a regulatory contaminant level is met. Examples of calculated values include average, 90th percentile, running annual average, locational running annual average.

contaminant

Potentially harmful physical, biological, chemical or radiological substance.

formal enforcement action

Escalated action taken by the state (due to the risk to public health, or number or severity of violations) to bring a noncompliant water system back into compliance.

health-based violation

Violation of either a maximum contaminant level or treatment technique.

Level 1 assessment

A study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 assessment

A very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli maximum contaminant level violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

locational running annual average (LRAA)

The average of sample results for samples collected at a particular monitoring location during the most recent four calendar quarters.

maximum contaminant level (MCL)

Highest level of a contaminant allowed in drinking water. MCLs are set as close to the maximum contaminant level goal as feasible using the best available treatment technology.

maximum contaminant level goal (MCLG)

Level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

maximum residual disinfection level (MRDL)

Highest level of a disinfectant allowed in drinking water. There is convincing evidence that the addition of disinfectant is necessary to control microbial contaminants.

maximum residual disinfection level goal (MRDLG)

The level of a drinking water disinfectant, below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

nephelometric turbidity unit (NTU)

Measure of the clarity or cloudiness of water. Turbidity in excess of 5 NTUs is just noticeable to the typical person.

non-health-based violation

A violation that is not a maximum contaminant level or treatment technique.

not applicable (N/A)

Does not apply or not available.

parts per billion (ppb)

Parts per billion = micrograms per liter (ppb = ug/L). One part per billion corresponds to one minute in 2,000 years or a single penny in \$10 million.

parts per million (ppm)

Parts per million = milligrams per liter (ppm = mg/L). One part per million corresponds to one minute in two years or a single penny in \$10,000.

picocuries per liter (pCi/L)

Measure of radioactivity in water.

range (R)

Lowest value to the highest value.

running annual average (RAA)

The average of sample results for samples collected during the most recent four calendar quarters.

sample size

Number or count of values. (i.e., number of water samples collected).

secondary maximum contaminant level (SMCL)

Non-enforceable, recommended limits for substances that may affect the taste, odor, color, or other aesthetic qualities of drinking water.

treatment technique (TT)

Required process intended to reduce the level of a contaminant in drinking water.

unregulated contaminant monitoring rule five (UCMR5)

The fifth list of unregulated contaminants, created by the Environmental Protection Agency, to be monitored by public water systems. A new list is determined every five years.

variance and exemptions

Department permission not to meet maximum contaminant level or treatment technique under certain conditions.

violation

Failure to meet a Colorado primary drinking water regulation.

WTP

Water treatment plant.

REGULATED WATER CONTAMINANTS: WHAT WE TEST FOR

Data collected throughout 2025

Denver Water monitors for the list of regulated parameters below in our treated drinking water. Sample points include entry points to the distribution system from our four treatment plants — Foothills, Marston, Moffat, Northwater — and sites throughout Denver Water’s distribution system. Moffat Treatment Plant is used for backup operations, typically during dry years, and was offline during the 2025 reporting period.

Inorganic Chemicals		Volatile Organic Chemicals		
Antimony	Thallium	Benzene	1,2-Dichloropropane	Trichloroethylene
Arsenic	Sodium	Carbon Tetrachloride	Ethylbenzene	Xylenes (total)
Barium	Total Chlorine	1,2-Dichloroethane	Monochlorobenzene	Vinyl Chloride
Beryllium	Fluoride	o-Dichlorobenzene	Styrene	
Cadmium	Nitrate	p-Dichlorobenzene	Tetrachloroethylene	
Chromium	Nitrite	1,1-Dichloroethylene	Toluene	
Mercury	Lead	cis-1,2-Dichloroethylene	1,2,4-Trichlorobenzene	
Nickel	Copper	trans-1,2-Dichloroethylene	1,1,1-Trichloroethane	
Selenium		Dichloromethane	1,1,2-Trichloroethane	
Synthetic Organic Chemicals		Disinfection Byproducts		
1,2-Dibromo-3-chloropropane	Endothall	Haloacetic Acids (HAA5) are regulated as the sum of the five contaminants listed below:	Total Trihalomethanes (TTHM) are regulated as the sum of the four contaminants listed below:	
2,4,5-TP	Endrin	Dibromoacetic Acid	Chloroform	
2,4-D	Ethylene dibromide	Dichloroacetic Acid	Bromodichloromethane	
Aldicarb	Heptachlor	Monobromoacetic Acid	Dibromochloromethane	
Aldicarb sulfone	Heptachlor Epoxide	Monochloroacetic Acid	Bromoform	
Aldicarb sulfoxide	Hexachlorobenzene	Trichloroacetic Acid		
Atrazine	Hexachlorocyclopentadiene	Radiological Contaminants		
Benzo(a)pyrene	Lasso (Alachlor)	Gross Alpha Emitters excluding Uranium		
BHC-Gamma	Methoxychlor	Combined radium (Radium 226 + Radium 228)		
Carbofuran	Oxamyl	Uranium		
Chlordane	Pentachlorophenol	Microbiological Contaminants		
Dalapon	Picloram	Total Coliform		
Di(2-ethylhexyl) adipate	Polychlorinated Biphenyls	<i>E.coli</i>		
Di(2-ethylhexyl) phthalate	Simazine	Other Regulated Contaminants		
Dinoseb	Toxaphene	Total Organic Carbon		
Diquat		Turbidity		

Foothills Treatment Plant

The data tables below include regulated contaminants from page 7 that were monitored for and detected at Foothills Treatment Plant, one entry point to the Denver Water distribution system, in 2025. If a contaminant from page 7 is not displayed in these tables, then it was not detected above the reporting limit at the sample location.

Inorganic contaminants detected at the entry point to the distribution system: Foothills Treatment Plant									
Chemical Parameters	Year	Sampling Frequency	Average	Range	Unit of Measure	MCL	MCLG	Standard Met	Typical Sources
Barium	2025	Monthly	40.0	34.0-45.1	ppb	2,000	2,000	✓	Erosion of natural deposits, discharge of drilling wastes.
Fluoride*	2025	Monthly	612	550-700	ppb	4,000 (2,000 is SMCL)*	4,000	✓	Erosion of natural deposits, water additive that promotes strong teeth, discharge from fertilizer and aluminum factories.
Nitrate as N	2025	Monthly	104	BRL-182	ppb	10,000	10,000	✓	Runoff from fertilizer use, leaching from septic tanks and sewage, erosion of natural deposits.
Nickel	2025	Monthly	1.0	BRL-1.6	ppb	N/A	N/A	✓	Discharge from industrial uses, such as transportation, chemical industry, electrical equipment and construction.
Sodium	2025	Monthly	23,742	17,900 -29,600	ppb	N/A	N/A	✓	Naturally occurring.
Chromium	2025	Monthly	0.5	BRL-1.8	ppb	100	100	✓	Discharge from steel and pulp mills, erosion of natural deposits.
Mercury	2025	Monthly	BRL	BRL-0.115	ppb	2	2	✓	Erosion of natural deposits, discharge from refineries, runoff from landfills and cropland.

*Secondary standards are non-enforceable guidelines for contaminants that may cause cosmetic effects (such as skin or tooth discoloration) or aesthetic effects (such as taste, odor or color) in drinking water.

Summary of turbidity sampled at the entry point to the distribution system: Foothills Treatment Plant								
Chemical Parameters	Year	Sampling Frequency	Level Found	Unit of Measure	Treatment Technique Requirement	Standard Met	Typical Sources	
Turbidity	2025	Daily	Highest single measurement: 0.108 NTU (April)	NTU	Maximum 1 NTU for any one single measurement.	✓	Soil runoff	
Turbidity	2025	Daily	Lowest monthly percentage of samples meeting TT requirement for our technology: 100%	NTU	In any month, at least 95% of samples must be less than 0.3 NTU.	✓	Soil runoff	

Turbidity has no health effects. However, turbidity can interfere with disinfection and provide a medium for microbial growth. Turbidity may indicate the presence of disease-causing organisms. These organisms include bacteria, viruses and parasites that can cause symptoms such as nausea, cramps, diarrhea and associated headaches.

Total organic carbon (disinfection byproducts precursor) removal ratio of raw and finished water: Foothills Treatment Plant					
Chemical Parameters	Year	Frequency	Treatment Technique Requirement	Standard Met	Typical Sources
Total Organic Carbon Ratio	2025	Once per month	Denver Water uses enhanced treatment to remove the required amount of natural organic material and/or demonstrates compliance with alternative criteria.	✓	Natural organic matter present in the environment.

Total organic carbon (TOC) has no health effects. However, total organic carbon provides a medium for the formation of disinfection byproducts including trihalomethanes (THMs) and haloacetic acids (HAAs). Drinking water containing these byproducts in excess of the MCL may lead to adverse health effects, liver or kidney problems, or nervous system effects, and may lead to an increased risk of getting cancer.

Marston Treatment Plant

The data tables below include regulated contaminants from page 7 that were monitored for and detected at Marston Treatment Plant, one entry point to the Denver Water distribution system, in 2025. If a contaminant from page 7 is not displayed in these tables, then it was not detected above the reporting limit at the sample location.

Inorganic contaminants detected at the entry point to the distribution system: Marston Treatment Plant									
Chemical Parameters	Year	Sampling Frequency	Average	Range	Unit of Measure	MCL	MCLG	Standard Met	Typical Sources
Barium	2025	Monthly	40.1	35.5-44.5	ppb	2,000	2,000	✓	Erosion of natural deposits, discharge of drilling wastes.
Fluoride*	2025	Monthly	619	530-750	ppb	4,000 (2,000 is SMCL)	4,000	✓	Erosion of natural deposits, water additive that promotes strong teeth, discharge from fertilizer and aluminum factories
Nitrate as N	2025	Monthly	84	BRL-187	ppb	10,000	10,000	✓	Runoff from fertilizer use, leaching from septic tanks, sewage, erosion of natural deposits.
Nickel	2025	Monthly	0.35	BRL-1.2	ppb	N/A	N/A	✓	Discharge from industrial uses such as transportation, chemical industry, electrical equipment and construction.
Sodium	2025	Monthly	23,820	19,100 -27,200	ppb	N/A	N/A	✓	Naturally occurring.
Chromium	2025	Monthly	0.2	BRL-1.8	ppb	100	100	✓	Discharge from steel and pulp mills, erosion of natural deposits.

*Secondary standards are non-enforceable guidelines for contaminants that may cause cosmetic effects (such as skin or tooth discoloration) or aesthetic effects (such as taste, odor or color) in drinking water.

Summary of turbidity sampled at the entry point to the distribution system: Marston Treatment Plant							
Chemical Parameters	Year	Sampling Frequency	Level Found	Unit of Measure	Treatment Technique Requirement	Standard Met	Typical Sources
Turbidity	2025	Daily	Highest single measurement: 0.081 NTU (February)	NTU	Maximum 1 NTU for any one single measurement.	✓	Soil runoff
Turbidity	2025	Daily	Lowest monthly percentage of samples meeting TT requirement for our technology: 100%	NTU	In any month, at least 95% of samples must be less than 0.3 NTU.	✓	Soil runoff

Turbidity has no health effects. However, turbidity can interfere with disinfection and provide a medium for microbial growth. Turbidity may indicate the presence of disease-causing organisms. These organisms include bacteria, viruses and parasites that can cause symptoms such as nausea, cramps, diarrhea and associated headaches.

Total organic carbon (disinfection byproducts precursor) removal ratio of raw and finished water: Marston Treatment Plant					
Chemical Parameters	Year	Frequency	Treatment Technique Requirement	Standard Met	Typical Sources
Total Organic Carbon Ratio	2025	Once per month	Denver Water uses enhanced treatment to remove the required amount of natural organic material and/or demonstrates compliance with alternative criteria.	✓	Natural organic matter present in the environment.

Total organic carbon (TOC) has no health effects. However, total organic carbon provides a medium for the formation of disinfection byproducts including trihalomethanes (THMs) and haloacetic acids (HAA5s). Drinking water containing these byproducts in excess of the MCL may lead to adverse health effects, liver or kidney problems, or nervous system effects, and may lead to an increased risk of getting cancer.

Northwater Treatment Plant

The data tables below include regulated contaminants from page 7 that were monitored for and detected at Northwater Treatment Plant, one entry point to the Denver Water distribution system, in 2025. If a contaminant from page 7 is not displayed in these tables, then it was not detected above the reporting limit at the sample location.

Inorganic contaminants detected at the entry point to the distribution system: Northwater Treatment Plant									
Chemical Parameters	Year	Sampling Frequency	Average	Range	Unit of Measure	MCL	MCLG	Standard Met	Typical Sources
Barium	2025	Monthly	20.2	17.3-23.7	ppb	2,000	2,000	✓	Erosion of natural deposits, discharge of drilling wastes.
Chromium	2025	Monthly	0.1	BRL-1.3	ppb	100	100	✓	Discharge from steel and pulp mills, erosion of natural deposits.
Fluoride*	2025	Monthly	573	BRL-690	ppb	4,000 (2,000 is SMCL)	4,000	✓	Erosion of natural deposits, water additive that promotes strong teeth, discharge from fertilizer and aluminum factories.
Nitrate as N	2025	Monthly	66	BRL-106	ppb	10,000	10,000	✓	Runoff from fertilizer use, leaching from septic tanks and sewage, erosion of natural deposits.
Sodium	2025	Monthly	12,300	10,500-14,500	ppb	N/A	N/A	✓	Naturally occurring.

*Secondary standards are non-enforceable guidelines for contaminants that may cause cosmetic effects (such as skin or tooth discoloration) or aesthetic effects (such as taste, odor, or color) in drinking water.

Summary of turbidity sampled at the entry point to the distribution system: Northwater Treatment Plant							
Chemical Parameters	Year	Sampling Frequency	Level Found	Unit of Measure	Treatment Technique Requirement	Standard Met	Typical Sources
Turbidity	2025	Daily	Highest single measurement: 0.170 NTU (March)	NTU	Maximum 1 NTU for any one single measurement.	✓	Soil runoff
Turbidity	2025	Daily	Lowest monthly percentage of samples meeting TT requirement for our technology: 100%	NTU	In any month, at least 95% of samples must be less than 0.3 NTU.	✓	Soil runoff

Turbidity has no health effects. However, turbidity can interfere with disinfection and provide a medium for microbial growth. Turbidity may indicate the presence of disease-causing organisms. These organisms include bacteria, viruses and parasites that can cause symptoms such as nausea, cramps, diarrhea and associated headaches.

Total organic carbon (disinfection byproducts precursor) removal ratio of raw and finished water: Northwater Treatment Plant					
Chemical Parameters	Year	Frequency	Treatment Technique Requirement	Standard Met	Typical Sources
Total Organic Carbon Ratio	2025	Once per month	Denver Water uses enhanced treatment to remove the required amount of natural organic material and/or demonstrates compliance with alternative criteria.	✓	Natural organic matter present in the environment.

Total organic carbon (TOC) has no health effects. However, total organic carbon provides a medium for the formation of disinfection byproducts including trihalomethanes (THMs) and haloacetic acids (HAA5s). Drinking water containing these byproducts in excess of the MCL may lead to adverse health effects, liver or kidney problems, or nervous system effects, and may lead to an increased risk of getting cancer.

The following data tables provide information on regulated contaminants in Denver Water’s distribution system.

Microbial contaminants regulated in the distribution system									
Name	Year	Sampling Frequency	MCL	MCLG	Unit of Measure	Highest Monthly Percentage	Number of Positives	Standard Met	Typical Sources
Total Coliform (T. coli)	2025	Daily	No more than 5% positive per month	0	Present/Absent	0.5% (present T.coli), July 2025	3 out of 4,770 total samples (0.06%); 0 E. coli positive samples	✓	Naturally present in the environment.

Disinfectants sampled in the distribution system*							
Name	Year	Results	Number of Samples Below Level	Frequency	MRDL	Standard Met	Typical Sources
Disinfectant as Total Cl2	2025	Lowest period percentage of samples above 0.2 ppm: 100%	0	Daily	4.0 ppm	✓	Drinking water disinfectant used to control microbial growth.

*Treatment technique requirement: At least 95% of samples per period (month or quarter) must be at least 0.2 ppm.

Lead and copper sampled in the distribution system									
Contaminant name	Period	Tap sample range: low-high	90th percentile	Sample size	Unit of measure	90th percentile action level	Sample sites above action limit	Standard Met	Typical Sources
Copper	1/1/2025 – 6/30/2025	BRL-263.4	60	337	ppb	1,300	0	✓	Corrosion of household plumbing and erosion of natural deposits.
Lead	1/1/2025 – 6/30/2025	BRL-126.1	4	337	ppb	15	1	✓	Corrosion of household plumbing and erosion of natural deposits.
Copper	7/1/2025 – 12/31/2025	BRL-288.3	40	245	ppb	1,300	0	✓	Corrosion of household plumbing and erosion of natural deposits.
Lead	7/1/2025 – 12/31/2025	BRL-98.8	3.1	245	ppb	15	3	✓	Corrosion of household plumbing and erosion of natural deposits.

Disinfection byproducts sampled in the distribution system										
Name	Year	Sampling Frequency	Highest Locational RAA	Range	Unit of Measure	MCL	MCLG	Standard Met	Typical Sources	
Total Trihalomethanes (TTHM)	2025	Quarterly	35.5	8.8-41.1	ppb	80	N/A	✓	Byproduct of drinking water disinfection.	
Haloacetic Acids (HAA5s)	2025	Quarterly	19.5	7.2-26.7	ppb	60	N/A	✓	Byproduct of drinking water disinfection.	

The data tables below provide information on unregulated parameters that were detected in Denver Water’s distribution system.

Water quality parameters with secondary maximum contaminant levels sampled in the distribution system									
Name	Year	Sampling Frequency	Average	Range	Unit of Measure	MCL	SMCL	Standard Met	Typical Sources
Aluminum	2025	Quarterly	31.4	21-86.1	ppb	N/A	50-200	✓	Erosion of natural deposits.
Chloride	2025	Quarterly	24,000	6,800-35,000	ppb	N/A	250,000	✓	Naturally occurring; road salt.
Copper	2025	Quarterly	5.4	BRL-45.6	ppb	N/A	1,000	✓	Corrosion of household plumbing, erosion of natural deposits.
Manganese	2025	Quarterly	1.9	BRL-25.7	ppb	N/A	50	✓	Naturally occurring.
Sulfate	2025	Quarterly	58,300	23,000-83,000	ppb	N/A	250,000	✓	Naturally occurring.
Zinc	2025	Quarterly	2.8	BRL-14.3	ppb	N/A	5,000	✓	Naturally occurring.

*Secondary standards are non-enforceable guidelines for contaminants that may cause cosmetic effects (such as skin or tooth discoloration) or aesthetic effects (such as taste, odor or color) in drinking water.

Additional water quality parameters sampled in the distribution system						
Name	Year	Sampling Frequency	Average	Range	Unit of Measure	Typical Sources
Alkalinity	2025	Monthly	65,037	41,000-82,000	ppb	Erosion of natural deposits.
Total Hardness	2025	Quarterly	105,009	55,000-124,000	ppb	Erosion of natural deposits.
Conductivity	2025	Quarterly	338	150-420	µs/cm	Naturally occurring.
Potassium	2025	Quarterly	1,985	690-2,860	ppb	Erosion of natural deposits.
Calcium	2025	Quarterly	29,750	18,200-36,000	ppb	Erosion of natural deposits.
Magnesium	2025	Quarterly	7,460	2,190-10,140	ppb	Erosion of natural deposits.

These parameters do not have an EPA MCL or SMCL, but they can clarify the buffering capacity and mineral content of the water. Some applications of these parameters include understanding scale buildup on water fixtures, caring for a home aquarium or brewing beer.

TESTING FOR UNREGULATED CONTAMINANTS

Since 1996, the Environmental Protection Agency, through its Unregulated Contaminant Monitoring Rule, every five years requires water utilities across the country to test for a list of substances that are suspected of being in drinking water but are not currently regulated under the Safe Drinking Water Act. Utilities report their test results to the EPA, which uses the information to learn more about the presence of these substances and decide whether they should be regulated in the future to protect public health.

Denver Water's 2025 test results were reported to the EPA as required. The data tables

below include substances that were detected during Denver Water's tests and the levels at which they were found.

The American Water Works Association has more information about the rule and the process on its website: [drinktap.org/Water-Info/Whats-in-My-Water/Unregulated-Contaminant-Monitoring-Rule-UCMR](https://www.drinktap.org/Water-Info/Whats-in-My-Water/Unregulated-Contaminant-Monitoring-Rule-UCMR). Information about the rule also can be found on the EPA's website at www.epa.gov/dwucmr/learn-about-unregulated-contaminant-monitoring-rule or you can contact the Safe Drinking Water Hotline at 800-426-4791 or water.epa.gov/drink/contact.cfm.

UCMR5: PFAS Contaminants Sampled at Entry Point to the Distribution System — All Treatment Plants					
Chemical Parameters	Year	Average	Range	Unit of Measure	Minimum Reporting Level
11-chloroeicosafuoro-3-oxaundecane-1-sulfonic acid (11Cl-PF3OUdS)	2023/2024/2025	BRL	BRL	ppb	0.005
1H,1H, 2H, 2H-perfluorohexane sulfonic acid (4:2FTS)	2023/2024/2025	BRL	BRL	ppb	0.003
1H,1H, 2H, 2H-perfluorooctane sulfonic acid (6:2FTS)	2023/2024/2025	BRL	BRL	ppb	0.005
1H,1H, 2H, 2H-perfluorodecane sulfonic acid (8:2 FTS)	2023/2024/2025	BRL	BRL	ppb	0.005
9-chlorohexadecafluoro-3-oxanonane-1-sulfonic acid (9Cl-PF3ONS)	2023/2024/2025	BRL	BRL	ppb	0.002
4,8-dioxa-3H-perfluorononanoic acid (ADONA)	2023/2024/2025	BRL	BRL	ppb	0.003
Hexafluoropropylene oxide dimer acid (HFPO DA)	2023/2024/2025	BRL	BRL	ppb	0.005
Nonafluoro-3,6-dioxahexanoic acid (NFDHA)	2023/2024/2025	BRL	BRL	ppb	0.02
Perfluorobutanoic acid (PFBA)	2023/2024/2025	BRL	BRL	ppb	0.005
Perfluorobutanesulfonic acid (PFBS)	2023/2024/2025	BRL	BRL	ppb	0.003
Perfluorodecanoic acid (PFDA)	2023/2024/2025	BRL	BRL	ppb	0.003
Perfluorododecanoic acid (PFDoA)	2023/2024/2025	BRL	BRL	ppb	0.003
Perfluoro(2-ethoxyethane)sulfonic acid (PFEEESA)	2023/2024/2025	BRL	BRL	ppb	0.003
Perfluoroheptanesulfonic acid (PFHpS)	2023/2024/2025	BRL	BRL	ppb	0.003
Perfluoroheptanoic acid (PFHpA)	2023/2024/2025	BRL	BRL	ppb	0.003
Perfluorohexanoic acid (PFHxA)	2023/2024/2025	BRL	BRL	ppb	0.003
Perfluorohexanesulfonic acid (PFHxS)	2023/2024/2025	BRL	BRL	ppb	0.003
Perfluoro-4-methoxybutanoic acid (PFMBA)	2023/2024/2025	BRL	BRL	ppb	0.003
Perfluoro-3-methoxypropanoic acid (PFMPA)	2023/2024/2025	BRL	BRL	ppb	0.004
Perfluorononanoic acid (PFNA)	2023/2024/2025	BRL	BRL	ppb	0.004
Perfluorooctanoic acid (PFOA)	2023/2024/2025	BRL	BRL	ppb	0.004
Perfluorooctanesulfonic acid (PFOS)	2023/2024/2025	BRL	BRL	ppb	0.004
Perfluoropentanoic acid (PFPeA)	2023/2024/2025	BRL	BRL	ppb	0.003
Perfluoropentanesulfonic acid (PFPeS)	2023/2024/2025	BRL	BRL	ppb	0.004
Perfluoroundecanoic acid (PFUnA)	2023/2024/2025	BRL	BRL	ppb	0.002
N-ethyl perfluorooctanesulfonamidoacetic acid (NEtFOSAA)	2023/2024/2025	BRL	BRL	ppb	0.005
N-methyl perfluorooctanesulfonamidoacetic acid (NMeFOSAA)	2023/2024/2025	BRL	BRL	ppb	0.006
Perfluorotetradecanoic acid (PFTeDA)	2023/2024/2025	BRL	BRL	ppb	0.008
Perfluorotridecanoic acid (PFTrDA)	2023/2024/2025	BRL	BRL	ppb	0.007

In 2023, three treatment plant entry points (Foothills, Marston and Moffat) were tested for Per- and polyfluoroalkyl substances (PFAS) under UCMR5 and were below the minimum reporting levels. In Q3 and Q4 of 2024 and Q1 and Q2 of 2025, Northwater Treatment Plant entry point was tested for Per- and polyfluoroalkyl substances (PFAS) under UCMR5 and was below the minimum reporting levels.

UCMR5: Lithium contaminant sampled at entry point to the distribution system: Foothills Treatment Plant					
Chemical Parameters	Year	Average	Range	Unit of Measure	Minimum Reporting Level
Lithium	2023	5.30	BRL-10.8	ppb	9

UCMR5: Lithium contaminant sampled at entry point to the distribution system: Marston Treatment Plant					
Chemical Parameters	Year	Average	Range	Unit of Measure	Minimum Reporting Level
Lithium	2023	9.23	9-9.4	ppb	9

UCMR5: Lithium contaminant sampled at entry point to the distribution system: Moffat Treatment Plant					
Chemical Parameters	Year	Average	Range	Unit of Measure	Minimum Reporting Level
Lithium	2023	BRL	BRL	ppb	9

UCMR5: Lithium contaminant sampled at entry point to the distribution system: Northwater Treatment Plant					
Chemical Parameters	Year	Average	Range	Unit of Measure	Minimum Reporting Level
Lithium	2024/2025	BRL	BRL	ppb	9



D DENVER WATER

1600 W. 12th Ave., Denver, CO 80204-3412
303-893-2444

For more information on water quality,
including opportunities for public participation, visit denverwater.org.

[DenverWater](https://www.facebook.com/DenverWater) [@DenverWater](https://twitter.com/DenverWater) [@DenverWater](https://www.instagram.com/DenverWater)
 [youtube.com/YourDenverWater](https://www.youtube.com/YourDenverWater) denverwater.org/TAP

Denver Water's Public Water System Identification: CO0116001

On the back cover: Since its founding more than a century ago, one of Denver Water's highest priorities has been to deliver safe, high-quality water to its customers. In this 1939 photo, employees collect water samples from various depths of the frozen Ralston Reservoir. Photo credit: Denver Water.